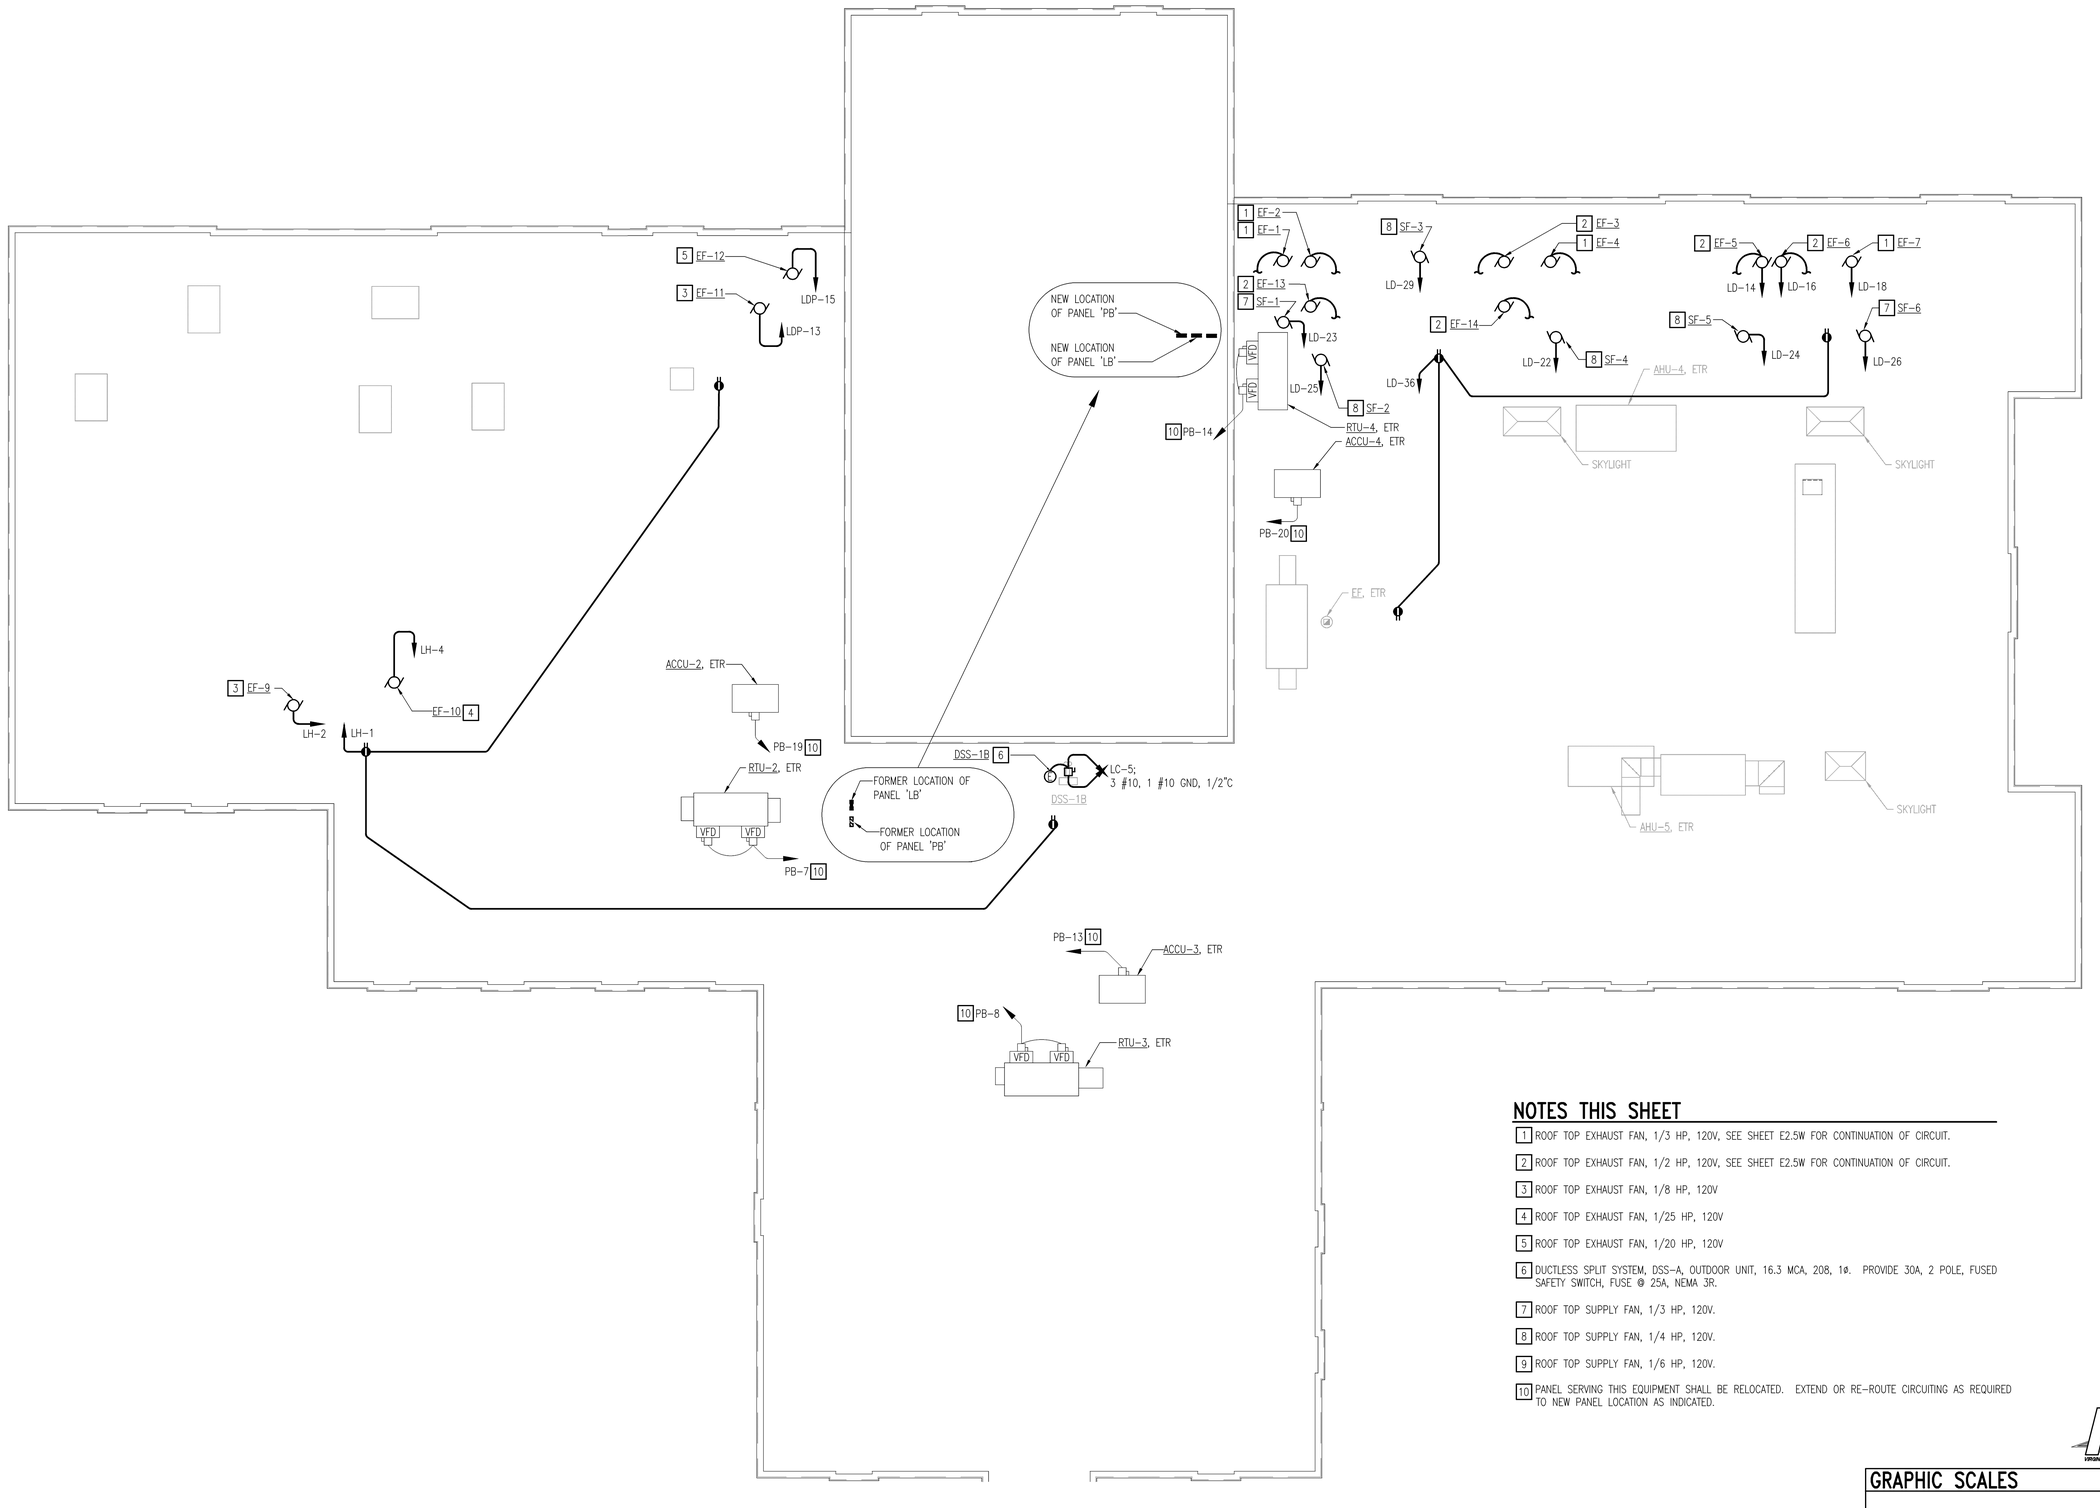

NOTES THIS SHEET

1. ROOF TOP EXHAUST FAN, 1/3 HP, 120V, SEE SHEET E2.5W FOR CONTINUATION OF CIRCUIT.
2. ROOF TOP EXHAUST FAN, 1/2 HP, 120V, SEE SHEET E2.5W FOR CONTINUATION OF CIRCUIT.
3. ROOF TOP EXHAUST FAN, 1/8 HP, 120V
4. ROOF TOP EXHAUST FAN, 1/25 HP, 120V
5. ROOF TOP EXHAUST FAN, 1/20 HP, 120V
6. DUCTLESS SPLIT SYSTEM, DSS-A, OUTDOOR UNIT, 16.3 MCA, 208, 1ø. PROVIDE 30A, 2 POLE, FUSED SAFETY SWITCH, FUSE @ 25A, NEMA 3R.
7. ROOF TOP SUPPLY FAN, 1/3 HP, 120V.
8. ROOF TOP SUPPLY FAN, 1/4 HP, 120V.
9. ROOF TOP SUPPLY FAN, 1/6 HP, 120V.
10. PANEL SERVING THIS EQUIPMENT SHALL BE RELOCATED. EXTEND OR RE-ROUTE CIRCUITING AS REQUIRED TO NEW PANEL LOCATION AS INDICATED.

NEW WORK ROOF PLAN - ELECTRICAL

3/32" = 1'-0"

GRAPHIC SCALES

3/32" = 1'-0" 5' 0' 5' 10' 20' 30'

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS NEW WORK
ROOF PLAN - ELECTRICAL

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

Pace COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-468-7229

COMMONWEALTH OF VIRGINIA
JOHN DEVAN
Lic. No. 013815
PROFESSIONAL ENGINEER
1-13-10

Sheet
E2.1W
File Number